

Experimental Performance Analysis of Refrigerant Mixture of R22/R152a In Air Conditioning System

Rajneesh Kaushik

ME (Thermal Engineering) student, Department of Mechanical Engineering – Thapar University Patiala.

Email: rajneesh.kaushik@gmail.com

Abstract: *In Indian households air conditioning system uses R22 refrigerant which has a very high Global Warming Potential (GWP) of 1700 and a ozone depletion potential (ODP) of 0.05. Hence a new refrigerant of low GDP is found. R152a is recognized as an option to R12 and R22 refrigerants. In this paper an experimental analysis has been done to lessen the usage of R22 with the Hydrocarbon Refrigerant mixtures (HCM) of R22 and R152a refrigerants in the proportion of 30:70, 50:50, and 70:30 by mass. Experiments were carried out by continuous running tests under an ambient temperature of 32°C. The performance of the system predicted that the HCM could be a long term replacement for R22 (chlorodifluoromethane)*

Keywords: Air conditioning, Refrigerant Mixture, Discharge Pressure, COP.

1. Introduction

The Refrigerant R22 is a sole hydro chloro fluoro carbon or HCFC compound, as per ASHRAE categorizations are commonly used in refrigeration and air conditioning systems. Due to high Ozone Layer Depleting Potential (ODP) and Global Warming Potential (GWP) of R22, it cannot be used in air conditioning system for long time. The resulted the idea of using substitute refrigerant having better eco friendly properties. Investigating the alternatives, R22 has got 0.05 ODP whereas it is found to be not easily miscible with the conventional mineral oil used as lubricant in air conditioners [1]. The substitute POE oil is highly hygroscopic. The miscibility problem can be overcome by adding suitable quantity of hydrocarbon additives [1,2]. Usage of R22 consumes more power up to 10-15% [3]. The COP of the system was also found to be 3% less than the system with R22 refrigerant [4]. Hydrocarbon refrigerants also have got the problem of flammability [5]. R404a was investigated and compared with the results of R22 and found to be feasible [6]. Hydrocarbon mixture of R290/R600a as an alternative to R22 in a domestic air conditioner was experimented and found to give an improved higher COP of 3.25-3.6% [7].

2. Theory of Air Conditioning

Air conditioning may be defined as the process where we process or condition the air as per the requirement. In summers, the conditioning is done in such a way that we get lower temperature in an enclosed space compared to outside conditions. Similarly, in winters, the conditioning is done to get higher temperature from outer conditions. This is done by incessant removal of heat from the enclosed space while the temperature is below than that of the surrounding temperature. The vapor compression air conditioning system is the widely accepted in the refrigeration and air conditioning process. It is sufficient for most conditioning applications. The normal vapor compression air conditioning systems are simple, low-priced, consistent and virtually maintenance free. Mainly of the domestic air Conditioners today are operational based on the vapor compression air conditioning system. It is rather equivalent to a reverse Rankine cycle. The vapor compression air conditioning systems have four main components which are compressor, evaporator, condenser and expansion device. Compressor is used to squeeze the small pressure and small temperature of refrigerant from the evaporator to elevated pressure and elevated temperature. After the compression process the refrigerant is then expelled into condenser. In the condenser, the condensation process needs heat elimination to the surroundings. The heat removal process is done in the condenser. It may be condensed at atmospheric temperature by rising the refrigerant's pressure and temperature over the atmospheric temperature. After the

condensation process, the condensed refrigerant will flow into the expansion device, where the temperature of refrigerant will be dropped lower than the surrounding temperature caused by the reducing pressure within the expansion device. When the pressure drops, the refrigerant vapor will expand. As the vapor expands, it draws the energy from its surroundings or the medium in contact with it and thus produces refrigeration effect to its surroundings. After this process, the refrigerant is ready to absorb heat from the space to be refrigerated. The heat absorption process is normally being called as evaporation process. The cycle is completed when the refrigerant returns to the suction line of the compressor after the evaporation process. Low temperature refrigeration, at temperatures below 0 C, affects everyday life. It is mostly used for food preservation, such as in the freezer of a air conditioner.

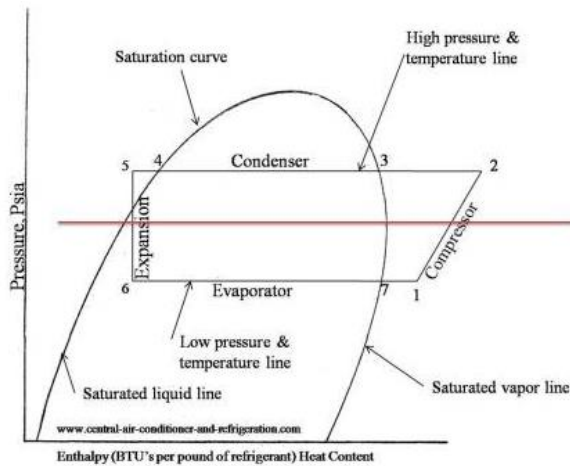


Figure 1: P-H Diagram for the Ideal Vapor Compression Refrigeration Cycle

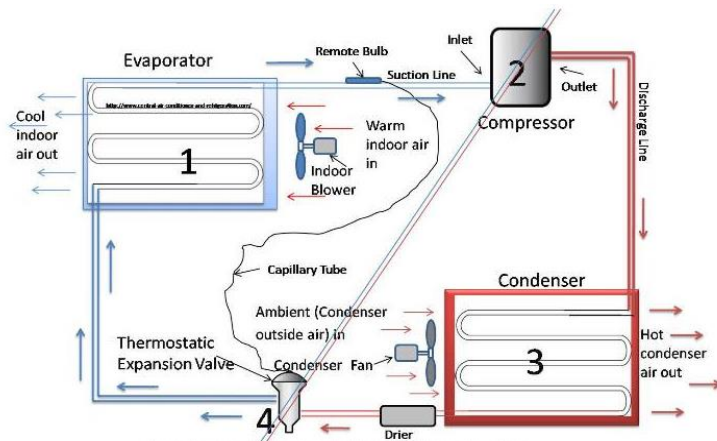


Figure 2: Schematic diagram

3. Experimental Setup

A. Components

The experimental consists of compressor, fan cooled condenser, expansion device and an evaporator section. Capillary tube is used as an expansion device. The evaporator is of coil type which is loaded with water. Service ports are provided at the inlet of expansion device and compressor for charging the refrigerant. The mass flow rate is measured with the help of flow meter fitted in the line between expansion device and drier unit. The experimental setup was placed on a platform in a constant room temperature. The ambient temperature was $\pm 1.5^{\circ}\text{C}$. The air flow velocity was found to be less than 0.35m/s.

B. Measurement

The temperatures at different parts of the experimental setup are measured using resistance thermocouples. 12 resistance thermocouples were used for the experimentation. The pressure at compressor suction, discharge,

condenser outlet and at evaporator outlet is measured with the help of pressure gauges. The power consumption of the system is measured by a digital Watt- hr meter. A digital wattmeter is also connected with the experimental setup. Table 1. Summarized the characteristics of the instrumentation.

Table 1: Measurement Equipment

Variable	Device	Range
Temperature	Pt100 PID controller	-50 to 199°C
Pressure	Pressure Gauge	0-10 bar
Power	Digital Watt/Watt-h Meter	5-20A

C. Leak Proof testing and charging of experimental setup

The fabricated experimental setup was filled with N₂ gas at a pressure of 5 to 7 bar and this pressure was maintained for 5 hrs. Thus the system was ensured for no leakages. The system was evacuated by removing N₂ gas. A vacuum pump was connected to the port provided in the compressor and the system was completely evacuated for the removal of any impurities. This process was carried out for all the trials. The refrigerant R22 and R152a was charged through the charging line to the compressor. Precision electronic balance with accuracy ±1% was used to charge into the system. Every time the system was allowed to stabilize for 10 min.

4. Experimental Procedure

The procedure for the conduction of experiments is as follows:

a) A performance test is made with the system loaded with pure R22. The data is treated as the basis for the comparison with the refrigerant mixtures.

Mixture of R152a and R22 by mass in the proportion 30:70, 50:50 and 70:30 was charged in the compressor and the performance tests were conducted.



5. Results and Discussion

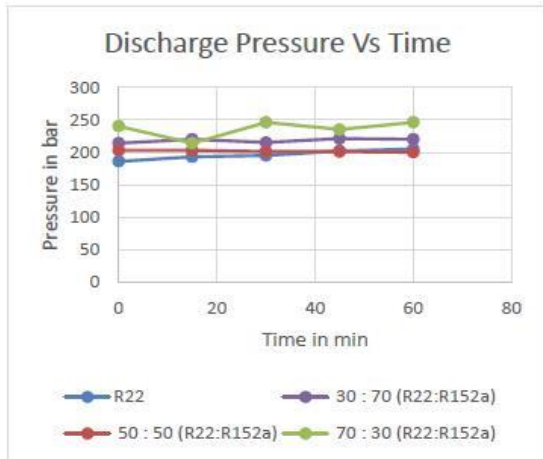


Figure 3: Variation of Discharge Pressure of Compressor with Time

The discharge pressure is found to increase with the mixture of refrigerants and higher discharge pressure was recorded for 0:30 mixtures of R152a and R22.


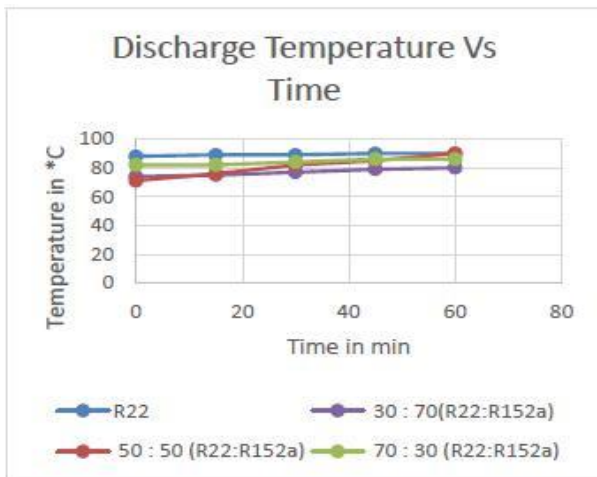


Figure 4: Variation of Discharge Temperature of Compressor with Time

The discharge temperature is found to increase with the mixture of refrigerants and higher discharge temperature was recorded for 70:30 mixtures of R152a and R22.

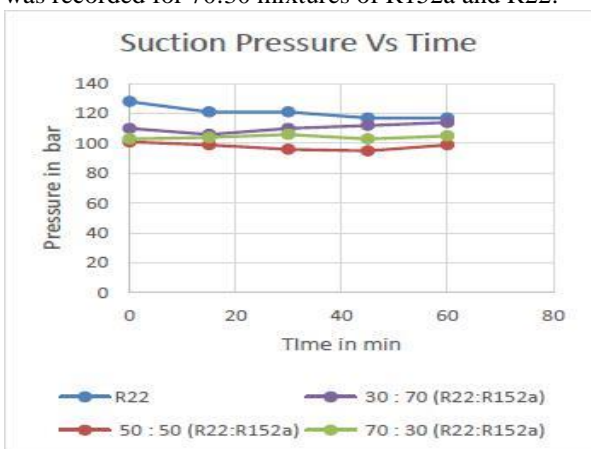

The suction pressure is found to decrease with the mixture of refrigerants.

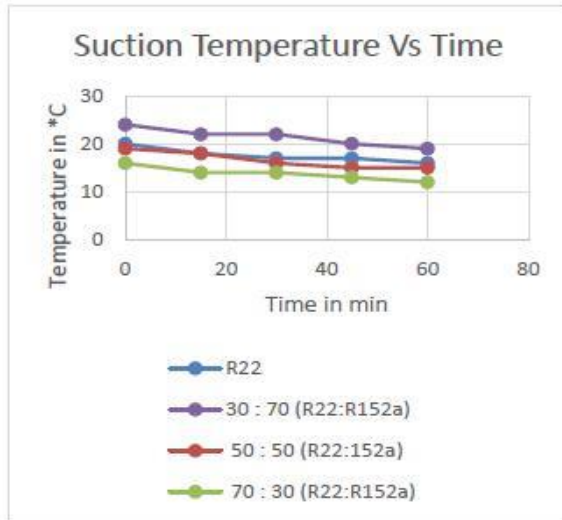


Figure 6: Variation of Suction Temperature of Compressor with Time

The suction temperature is found to decrease with the mixture of refrigerants and lower suction temperature was recorded for 70:30 mixtures of R152a and R22.

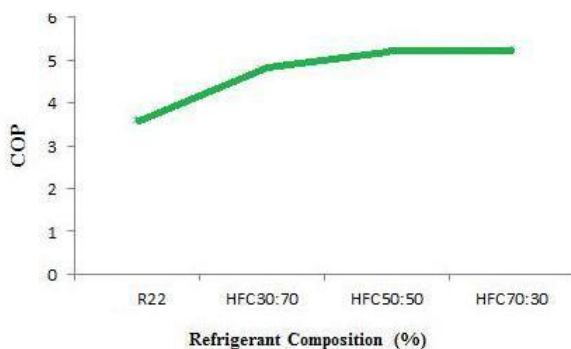


Figure 7: Variation of COP with Refrigerant Mixture

The COP value increases with the increase of refrigerant mixture and the highest value of COP found experimentally was 5.26

6. Conclusion

- 1) The mixture of R152a and R22 works safely in the system without any system modification.
- 2) The discharge temperature is found to increase with the mixture of refrigerants and higher discharge temperature was recorded for 70:30 mixtures of R152a and R22
- 3) The COP value increases and the maximum COP was obtained for 70:30 mixtures of R152a and R22.
- 4) Highest value of COP found experimentally is 5.26.

The obtained results matches with the earlier research trends.[26]

References

- [1] Murat Hozod (2005). "Performance Comparison of Single-Stage and Cascade Air conditioning systems Using R22 as the Working Fluid," Turkish J. Eng. Env. Sci Vol 29, 285-269.
- [2] Rotchana Prapainnop, K O Suen (2012). "Effects of refrigerant properties on refrigerant performance comparison: A review," International Journal of Engineering and Research and Applications Vol. 2, pp. 486-493.
- [3] Guo-liang Ding (2007). "Recent developments in simulation techniques for vapour-compression air conditioning systems," International Journal of Refrigeration Vol. 30, 1119-1133
- [4] Miguel Padilla, Remi Revellin, Jocelyn Bonjour (2010). "Exergy analysis of R413A as replacement of R12

- in a domestic air conditioning system,” *Energy “Conversion and Management* Vol. 51, 2195-2201.
- [5] M. Y. Taib, A. A. Aziz, A. B. S. Alias (2010). “Performance Analysis of a Domestic Airconditioner,” *National Conference in Mechanical Engineering Research and Postgraduate students*.
- [6] Abhishek Tiwari, R. C. Gupta (2011). “Experimental Study of R-404A and R-134A in Domestic Airconditioner,” *International Journal of Engineering Science and Technology* Vol 3, 6390-6393.
- [7] J. K. Dabas, A. K. Dodeja, Sudhir Kumar, K. S. Kasana (2011). “Impact of Refrigerant Charge over the Performance Characteristics of a Simple Vapour Compression Refrigeration System,” *International Journal of Advances in Engineering and Technology* Vol 1 , 267-277.
- [8] N. Subramani, M. J. Prakash (2011). “Experimental studies on a vapour compression system using nano refrigerants,” *International Journal of Engineering Science and Technology* Vol. 3, pp. 95-102
- [9] S. J. Sekhar, D. M. Lal (2005). “HFC 134a/HC600a/HC290 mixture a retrofit for CFC12 systems,” *International Journal of Refrigeration* Vol:28, 735-743
- [10] I. M. Mahbulul, S. A. Fadhilah, R. Saidur, K. Y. Leong, M. A. Amalina (2013). “Thermo physical properties and heat transfer, Performance of Al₂O₃/R-134a nanorefrigerants,” *International Journal of Heat and Mass Transfer* Vol. 57, 100-108.
- [11] Min Zhang, Ruixiang Wang, Jiangfeng Lou (2011). “Actuality and application foreground of nanofluids in refrigeration,” *Materials Science Forum* Vol. 694, 261-265
- [12] I. M. Mahbulul, R. Saidur, M.A. Amalina (2011). “Pressure Drop Characteristics of TiO₂-R123 Nano refrigerant in a Circular Tube,” *Engineering e-Transaction* Vol. 6, pp. 124-130.
- [13] Ching-Song Jwo, Chen-Ching Ting, Wei-Ru Wang (2009). “Efficiency analysis of home airconditioners by replacing hydrocarbon refrigerants” Vol 42 697-701
- [14] B. O. Bolaji, M.A. Akintunde, T. O. Falade (2011). Comparative Analysis of Performance of Three Ozone-Friends HFC Refrigerants in a Vapour Compression Refrigeration,” *Journal of Sustainable and Environment* Vol. 2, 61-64
- [15] Bolaji, B.O. (2010). "Experimental Study of R152a and R32 to replace R22 in a domestic airconditioner," *Int J of Energy*, Vol 35, pp 3793-3798.
- [16] Mohanraj, M (2009). Experimental investigation of R290/R600a mixture as an alternative to R22 in a domestic airconditioner,” *Int. J. of Thermal Sciences*, Vol. 48, 1036-1042.
- [17] Ching-Song Jwo (2008) “Experimental Study on Thermal Conductivity of Lubricant containing Nanoparticles,” *Rev Adv Mater Science*, Vol. 18, 660-666.
- [18] Avinash, (2011). “Development of Energy efficient R22 Automotive Air-conditioning system using Internal Heat Exchanger,” *Proceedings of World Congress on Engineering*, Vol III, 76-82
- [19] Kai-Shing Yang, (2010) “An investigation of a Top-mounted domestic airconditioner ,” *Int J of Energy Conservation and Management* , Vol. 51, 1422-1427
- [20] Shengshan Bi, (2011) “ Performance of a Domestic Airconditioner using TiO₂-R600a nano-refrigerant as working fluid,” *Int J of Energy Conservation and Management*, Vol. 52, 733-737
- [21] Saidur, R, (2011) “A Review on the performance of nano-particles suspended with refrigerants and lubricating oils in air conditioning system,” *Int J of Renewable and Sustainable Energy Reviews*, Vol. 15, 310-323.
- [22] Joseph Sekher, S. (2004). Improved energy efficiency for CFC domestic airconditioners retrofitted with ozone friendly HFC134a,” *Int J of Thermal Sciences*, Vol. 43, 307-314.
- [23] Ching-Song Jwo (2012). “Efficiency analysis of home airconditioners by replacing hydrocarbon airconditioners,” *Int J of Measurement*, Vol. 42,697-701
- [24] T .M. I. Mahlia, R. Saidur (2010). “A review on test procedure, energy efficiency standards and energy labels for room air conditioners and airconditioner-freezers,” *Renewable and Sustainable Energy Reviews* Vol. 14, 1888-1900.
- [25] D.Sendil Kumar, Dr.R.Elansezhian (2012), “Experimental study of Al₂O₃ nano-refrigerant in air conditioning system”, *International Journal of Modern Engineering Research*, Vol.2, Issue 5, Sept-Oct 2012, pp3390-3397.
- Abhishek Tiwari, R. C. Gupta (2011). “Experimental Study of R-404A and R-134A in Domestic Refrigerator,” *International Journal of Engineering Science and Technology* Vol. 3, 6390-6393.